


NOTES

1. METER TO BE SET HORIZONTALLY. RUN WIRE FROM METER TO OUTSIDE FRONT FOR REMOTE(BY PLUMBER)
2. BENDS IN REMOTE READER CONDUIT NO GREATER THAN 45° EXCEPT 90° PERMITTED AT EXIT.
3. SECURE METER RACK ABOVE AND BELOW TO PREVENT STRAIN ON PIPING.
4. CHARLES COUNTY ISSUES AND SETS METER W/ REMOTE.

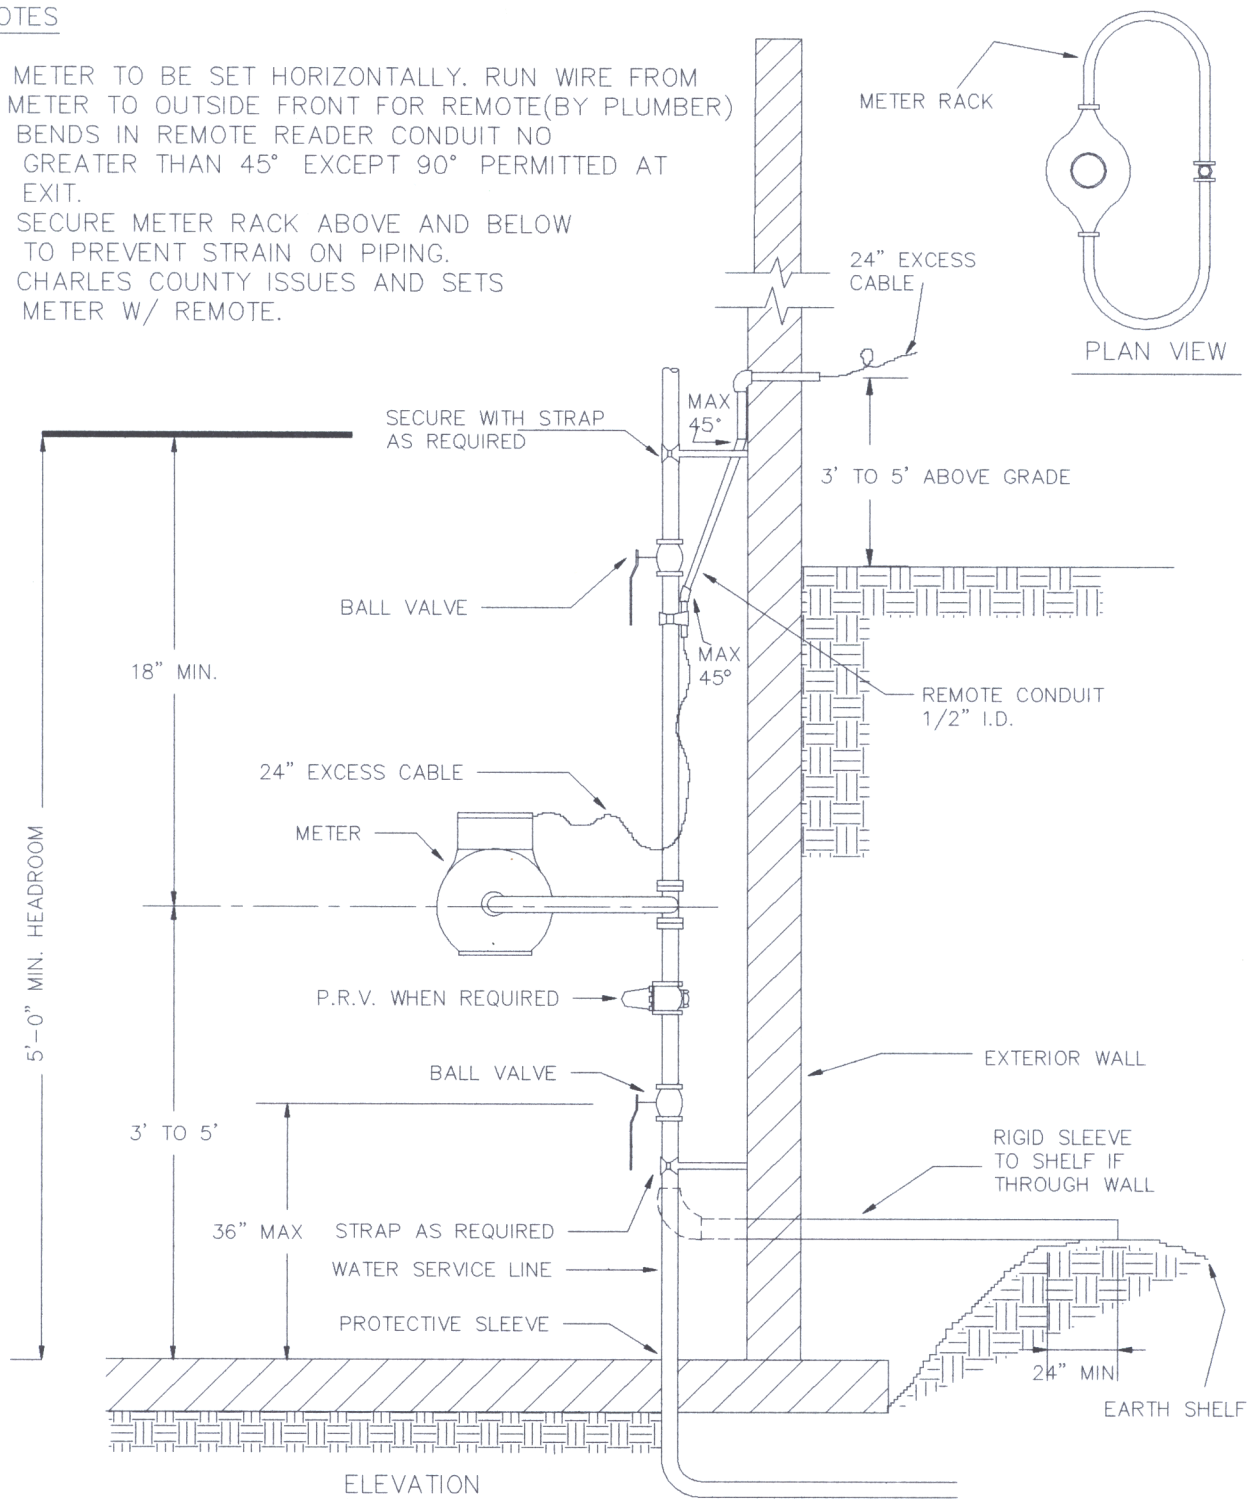

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED:

[Signature] 6/29/95
DIRECTOR OF DEVELOPMENT SERVICES DATE
[Signature] 6/29/95
WATER / SEWER ENGINEER DATE

STANDARD DETAIL

INSIDE WATER METER
SETTING 1"
AND SMALLER.

REVISIONS:

W
6.01